

Technical data sheet



Communicative globe valve actuator with emergency control function for 2-way and 3-way globe valves

- Actuating force 1000 N
- Nominal voltage AC/DC 24 V
- Control Modulating DC (0)2...10 V Variable
- Nominal stroke 20 mm
- Actuating time 35 s / 20 mm
- Communication via BELIMO MP-Bus
- Conversion of sensor signals
- Design life SuperCaps: 15 years



Technical data

| Electrical data | Nominal voltage | AC/DC 24 V |
|-----------------|--|---|
| | Nominal voltage frequency | 50/60 Hz |
| | Nominal voltage range | AC 19.228.8 V / DC 21.628.8 V |
| | Power consumption in operation | 4.5 W |
| | Power consumption in rest position | 1.5 W |
| | Power consumption for wire sizing | 9 VA |
| | Connection supply / control | Terminals with cable 1 m, 4 x 0.75 mm ² (Terminal 4 mm ²) |
| | Parallel operation | Yes (note the performance data) |
| Functional data | Actuating force | 1000 N |
| | Positioning signal Y | DC 010 V |
| | Positioning signal Y note | Input impedance 100 kΩ |
| | Control signal Y variable | Open-close |
| | | 3-point (AC only) |
| | | Modulating (DC 032 V) |
| | Operating range Y | DC 210 V |
| | Operating range Y variable | Start point DC 0.530 V |
| | | End point DC 2.532 V |
| | Position feedback U | DC 210 V |
| | Position feedback U note | Max. 0.5 mA |
| | Position feedback U variable | Start point DC 0.58 V |
| | | End point DC 2.510 V |
| | Setting emergency position (POP) | Actuator spindle 0100%, adjustable (POP rotary button) |
| | Bridging time (PF) variable | 110 s |
| | Position accuracy | 5% absolute |
| | Manual override | Gear disengagement with push-button |
| | Nominal stroke | 20 mm |
| | Actuating time | 35 s / 20 mm |
| | Actuating time variable | 3590 s / 20 mm |
| | Actuating time emergency control function | 35 s / 20 mm |
| | Adaption setting range | manual (automatic on first power-up) |
| | Adaption setting range variable | No action |
| | | Adaption when switched on |
| | | Adaption after pushing the gear disengagement |
| | | button |
| | Override control | MAX (maximum position) = 100% |
| | | MIN (minimum position) = 0% |
| | | ZS (intermediate position, AC only) = 50% |
| | Override control variable | MAX = (MIN + 33%)100% MIN = 0%(MAX - 33%) |
| | | ZS = MINMAX |
| | Sound power level motor | 60 dB(A) |
| | Sound power level emergency control | 60 dB(A) |
| | position | |
| | Position indication | Mechanically, 520 mm stroke |
| Safety | Protection class IEC/EN | III Safety extra-low voltage |
| | Degree of protection IEC/EN | IP54 |
| | | |

Globe valve actuator, communicative, Modulating, AC/ DC 24 V, 1000 N, Actuating time 35 s / 20 mm



| Technical data | | | |
|------------------|-------------------|--|---|
| | Safety | EMC | CE according to 2004/108/EC |
| | | Certification IEC/EN | IEC/EN 60730-1 and IEC/EN 60730-2-14 |
| | | Mode of operation | Type 1.AA |
| | | Rated impulse voltage supply / control | 0.8 kV |
| | | Control pollution degree | 3 |
| | | Ambient temperature | 050°C |
| | | Non-operating temperature | -4080°C |
| | | Ambient humidity | 95% r.h., non-condensing |
| | | Maintenance | Maintenance-free |
| | Weight | Weight approx. | 1.7 kg |
| | Terms | Abbreviations | POP = Power off position / emergency setting position CPO = Controlled power off / controlled emergency control function PF = Power fail delay time / bridging time |
| Safety notes | | | |
| | | conditioning systems and is not allow application, especially in aircraft or ir Only authorised specialists may carr institutional installation regulations m The switch for changing the direction adjusted only by authorised specialis in connection with frost protection cir The device may only be opened at th parts that can be replaced or repaire The device contains electrical and elements of the second second | n of motion and so the closing point may be sts. The direction of motion is critical, particularly rcuits. he manufacturer's site. It does not contain any |
| Product features | | | |
| | Mode of operation | | dard modulating signal of DC 010 V and moves ng signal at the same time as the integrated |

The actuator receives its digital positioning signal from the higher level controller via the MP-Bus and travels to the position defined. Connection U serves as communication interface and does not supply an analogue measuring voltage.

Globe valve actuator, communicative, Modulating, AC/ DC 24 V, 1000 N, Actuating time 35 s / 20 mm



Product features


Pre-charging time (start up)

The capacitor actuators require a pre-charging time. This time is used for charging the capacitors up to a usable voltage level. This ensures that, in the event of an electricity interruption, the actuator can move at any time from its current position into the preset emergency setting position (POP).

The duration of the pre-charging time depends mainly on following factors:

- Duration of the electricity interruption
- PF delay time (bridging time)

Typical pre-charging time

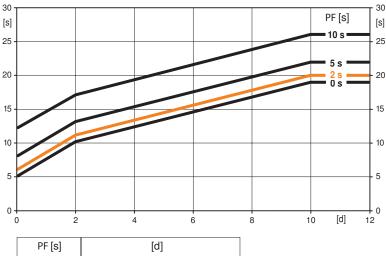

| | [5] | | | լսյ | | |
|--------|-----|----|----|-----|----|---|
| | | 0 | 1 | 2 | 7 | |
| | 0 | 5 | 8 | 10 | 15 | |
| • | 2 | 6 | 9 | 11 | 16 | |
| r | 5 | 8 | 11 | 13 | 18 | |
| [F | 10 | 12 | 15 | 17 | 22 | |
| • | | | | [s] | | |
| | | | | | | 1 |

[d] = Electricity interruption in days [s] = Pre-charging time in seconds PF[5] = Bridging time Calculation example: Given an electricity interruption of 3 days and a bridging time (PF) set at 5 s, the actuator requires a pre-charging time of 14 s after the electricity has been reconnected (see graphic).

Delivery condition (capacitors)

Converter for sensors

The actuator is completely discharged after delivery from the factory, which is why the actuator requires approximately 20 s pre-charging time before initial commissioning in order to bring the capacitors up to the required voltage level.

≥10

19

20

22

26

Connection option for a sensor (passive or active sensor or switching contact). The MP actuator serves as an analogue/digital converter for the transmission of the sensor signal via MP-Bus to the higher level system.

Parameterisable actuators The factory settings cover the most common applications. Input and output signals and other parameters can be altered with the PC-Tool MFT-P or with the Service tool ZTH EU.

Direct mounting Simple direct mounting on the globe valve by means of form-fit hollow clamping jaws. The actuator can be rotated by 360° on the valve neck.

Manual overrideManual control with push-button possible - temporary. The gear is disengaged and the
actuator decoupled for as long as the button is pressed.
The stroke can be adjusted by using a hexagon socket screw key (4 mm), which
is inserted into the top of the actuator. The stroke spindle extends when the key is

High functional reliability The actuator is overload protected, requires no limit switches and automatically stops when the end stop is reached.

rotated clockwise.

Combination valve/actuator Refer to the valve documentation for suitable valves, their permitted medium temperatures and closing pressures.

Position indication The stroke is indicated mechanically on the bracket with tabs. The stroke range adjusts itself automatically during operation.

NVKC24A-MP-TPC

Globe valve actuator, communicative, Modulating, AC/ DC 24 V, 1000 N, Actuating time 35 s / 20 mm



| Product features | |
|--|--|
| Home position | Factory setting: Actuator spindle is retracted. When valve-actuator combinations are shipped, the direction of motion is set in accordance with the closing point of the valve. The first time the supply voltage is switched on, i.e. at the time of commissioning, the actuator carries out an adaption, which is when the operating range and position feedback adjust themselves to the mechanical setting range. The actuator then moves into the position defined by the positioning signal. |
| Direction of stroke switch | When actuated, the direction of stroke switch changes the running direction in normal operation. The direction of stroke switch has no influence on the emergency setting position (POP) which has been set. |
| Adaption and synchronisation | An adaption can be triggered manually by pressing the "Adaption" button or with the PC-Tool. Both mechanical end stops are detected during the adaption (entire setting range). Automatic synchronisation after pressing the gearbox disengagement button is configured. The synchronisation is in the home position (0%). The actuator then moves into the position defined by the positioning signal. A range of settings can be adapted using the PC-Tool (see MFT-P documentation) |
| Rotary knob emergency setting position | The «Emergency setting position» rotary knob can be used to adjust the desired emergency setting position (POP). In the event of an electricity interruption, the actuator will move into the selected emergency setting position, taking into account the bridging time (PF) of 2 s which was set ex-works. Settings: The rotary knob must be set to the «Tool» position for retroactive settings of the emergency setting position with the BELIMO service tool MFT-P. Once the rotary knob is set back to the range 0100%, the manually set value will have positioning authority |
| Bridging time (PF) | Electricity interruptions can be bridged up to a maximum of 10 s. In the event of an electricity interruption, the actuator will remain stationary in accordance with the set bridging time. If the electricity interruption is greater than the set bridging time, then the actuator will move into the selected emergency setting position (POP). The bridging time set ex-works is 2 s. This can be modified on site in operation with the use of the BELIMO service tool MFT-P. Settings: The rotary knob must not be set to the «Tool» position! Only the values need to be entered for retroactive adjustments of the bridging time with the BELIMO service tool MFT-P. |


Accessories

| | Description | Туре |
|------------------------|--|------------|
| Gateways | Gateway MP for BACnet MS/TP, AC/DC 24 V | UK24BAC |
| | Gateway MP to Modbus RTU, AC/DC 24 V | UK24MOD |
| | Gateway MP for LonWorks®, AC/DC 24 V, LonMark-certified | UK24LON |
| | Gateway MP to KNX/EIB, AC/DC 24 V, EIBA certified | UK24EIB |
| | Description | Туре |
| Electrical accessories | Connecting cable 5 m, A+B: RJ12 6/6, To ZTH/ZIP-USB-MP | ZK1-GEN |
| | Connection cable 5 m, A: RJ11 6/4, B: Free wire end, To ZTH/ZIP-USB-MP | ZK2-GEN |
| | MP-Bus power supply for MP actuators, AC 230/24V for local power supply | ZN230-24MP |
| | Connecting board MP bus suitable for wiring boxes EXT-WR-FPMP | ZFP2-MP |
| | Auxiliary switch, 2 x SPDT, add-on | S2A-H |
| | Description | Туре |
| Service Tools | Service Tool, for MF/MP/Modbus/LonWorks actuators and VAV- Controller | ZTH EU |
| | Belimo PC-Tool, software for adjustments and diagnostics | MFT-P |
| | Adapter to Service-Tool ZTH | MFT-C |


Globe valve actuator, communicative, Modulating, AC/ DC 24 V, 1000 N, Actuating time 35 s / 20 mm




Electrical installation



Wiring diagrams






Cable colours: 1 = black

2 = red

3 = white



Power topology

Operation on the MP-Bus


Cable colours:

- 1 = black
- 2 = red
- 3 = white 5 = orange


Functions

Functions when operated on MP-Bus


Connection on the MP-Bus



Connection of active sensors



Connection of passive sensors



| Ni1000 | –28+98°C | 8501600 Ω ²⁾ |
|--------|-------------------------|-----------------------------|
| PT1000 | –35+155°C | 8501600 Ω ²⁾ |
| NTC | -10+160°C ¹⁾ | $200~\Omega60~k\Omega^{2)}$ |

A) more actuators and sensors

A) more actuators and sensors

• Supply AC/DC 24 V

(max. DC 0...32 V)


Resolution 30 mV

Output signal DC 0...10 V

(max.8)

(max.8)


A) more actuators and sensors (max.8) 1) Depending on the type 2) Resolution 1 Ohm



There are no restrictions for the network topology (star, ring, tree or mixed forms are permitted). Supply and communication in one and the same 3-wire cable • no shielding or twisting necessary

· no terminating resistors required

Connection of external switching contact



A) more actuators and sensors (max.8)


 Switching current 16 mA @ 24 V · Start point of the operating range must be parameterised on the MP actuator as $\ge 0.5 \text{ V}$





Functions

Functions with basic values (conventional mode)


Override control with AC 24 V with relay contacts









Remote control 0...100% with positioner SG..






Minimum limit with positioner SG..




 \subset

Follow-up control (position-dependent)

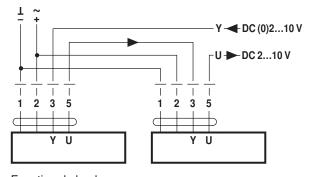






Procedure

- 1. Apply 24 V to connection 1 and 2
- 2. Disconnect connection 3:
- with upwards direction of motion:
- closing point at top
- with downwards direction of motion: closing point at bottom
- 3. Short circuit connections 2 and 3:
- Actuator runs in the opposite
- direction



γ U

Control with 4...20 mA via external resistor

Caution:

The operating range must be set to DC 2...10 V. The 500 Ω resistor converts the 4...20 mA current signal to a voltage signal DC 2...10 V




Override control with AC 24 V with rotary switch



Functions

Functions for actuators with specific parameters (Parametrisation with PC-Tool necessary)

Override control and limiting with AC 24 V with relay contacts



d а b с е 七 1 七 Υ +

Close ¹⁾ MIN ZS MAX Open T - 表し 0 I I 2 3 5 U


Override control and limiting with AC 24 V with rotary switch


10 < (DC 0...


+

e.g. 1N 4007


¥







Control 3-point




NVKC24A-MP-TPC

Globe valve actuator, communicative, Modulating, AC/ DC 24 V, 1000 N, Actuating time 35 s / 20 mm



Operating controls and indicators

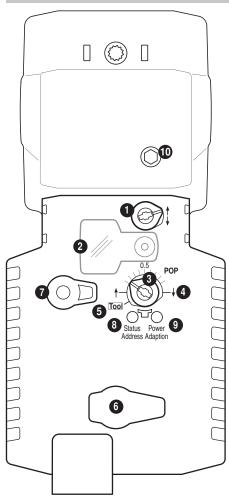

 Direction of stroke switch Switch over: Direction of stroke changes
 Cover, POP button
 POP button
 Scale for manual adjustment
 Scale for adjustment with tool
 Service plug For connecting the parameterisation and service tools
 Gear disengagement button

Press button: Gear disengaged, motor stops, manual override possible Release button: Gear engaged, standard mode

| LED displays yellow green | | Meaning / function |
|-----------------------------------|----------|--|
| Off | On | Operation OK |
| Off | Flashing | POP function active |
| On | Off | Pre-charging time SuperCap, Fault SuperCap or wiring error in supply |
| Off | Off | Not in operation |
| On | On | Adaptation process active |
| Flickering | On | Communication active |

8 Push-button (LED yellow)

Press button: Confirmation of addressing


9 Push-button (LED green)

Press button Triggers stroke adaptation, followed by standard mode

10 Manual override


Clockwise: Actuator spindle extends Counterclockwise: Actuator spindle retracts

Emergency position (POP) setting

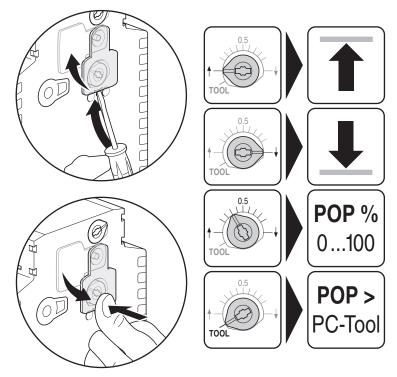

Globe valve actuator, communicative, Modulating, AC/ DC 24 V, 1000 N, Actuating time 35 s / 20 mm



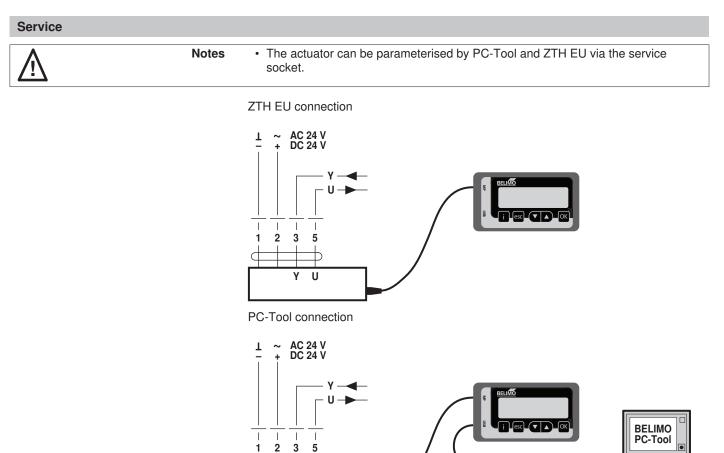



Dimensions [mm]

Dimensional drawings

t

ΥU





USB

Further documentation

- Overview Valve-actuator combinations
- Data sheets for globe valves
- · Installation instructions for actuators and/or globe valves
- Notes for project planning 2-way and 3-way globe valves
- General notes for project planning